



ISSN: 2319-5967

ISO 9001:2008 Certified

International Journal of Engineering Science and Innovative Technology (IJESIT)

Volume 2, Issue 2, March 2013

# Mitigation of Harmonics in A.C.Drive by using multi-Pulse Transformer Solution

Shashikant R. Vaishnani, Hardik H. Raval, Bhavans N. Shah  
PG Student, IV<sup>th</sup> SEM, Electrical Engineering Department, G.E.C, Bhuj India

*Abstract: With the increasing of use of power electronic controlled variable speed drives in industries, power quality distortion in electric power system has become a serious issue in recent years. In steel plants, because of presence of more number of adjustable speed electric drives, this problem is a greater concern. In this paper, the impacts of harmonic distortions due to Adjustable speed electric drives in Jindal Saw Ltd, Mundra, Gujarat, India is investigated. Harmonic measurements at various motor drives with the help of Fluke 434 power quality analyzer have been done to determine where a significant amount of harmonic currents or voltages are presented. From these measurements and subsequent calculations, the impact of harmonics is analyzed and found that the harmonic content of the motor drives to be minimized within the limits of international harmonic standards. In recently, multi pulse drive solution gained an increased attention due to their effective harmonic reduction. In this paper a phase shifting transformer has been developed for minimization of the harmonics, which is implemented in Matlab/Simulink based on real time measurement of harmonic data*

**Keywords:** Adjustable Speed Drives, Harmonics, Phase shifting transformer, Powerquality, PWM Generator block.

## I. INTRODUCTION

The In modern power system, due to increase controlling technology, power quality has become a great concern. Non-linear loads, which were only 15 % of total loads in 1987, have increased to 75 % in 2012. These non-linear loads introduce harmonics into the supply system and draw non-sinusoidal currents from ac mains and cause reactive power burden, excessive neutral current, Low power factor, Low energy efficiency, interference by EMI and distortion of the line voltage, etc. [1,2]. The variable speed drives come under non-linear loads and they are one of the major source of harmonics generation and power quality [problems]. Harmonics are the main cause of power quality of the electrical power system. Therefore, the standard regulations and recommendations such as IEC 61000-3-2 and IEEE 519 enforce to limit the above problems [3]. Filtering is a common method for suppressing harmonics [4, 5]. In this paper, the impact so harmonic distortions due to electric drives in Jindal Saw Ltd, Mundra, Kutchh-Bhuj (Dist), Gujarat, India, which is a major supplier of steel to most of the Industries/organizations in all over the world, is investigated. The harmonic measurement is done with Fluke 431 A power quality analyzer. From the measured data, it is found that the harmonic content of motor drives needs to be reduced within the limits of international harmonic standards. In recently, multi-pulse technology gained an increased attention due to their effective harmonic reduction. In this paper, an advance strategy has been designed for minimization of the harmonics and results are presented in terms of % THD without and with advance strategy. Standard AC drive topologies utilize AC-DC-AC power conversion with a three phase rectifying bridge for the AC-DC function. A three-phase diode or SCR bridge generates 6 pulse types current that is ~ 32% rich in total harmonic current distortion [2]. As ac drives proliferate, equipment system specifications limiting the amount of harmonic current injected into the grid are becoming more common and thus solicit cost effective harmonic mitigation solution.

## II. ANALYSIS OF HARMONICS IN STEEL PLANT

Power quality problems especially harmonic distortion associated with non-linear load such as Variable Frequency Drive (VFDs) and Induction Furnace are addressed in several papers in general, but paper deal with harmonic distortion in a steel industry is found to be very less. Hence, an attempt has been made in this paper to study harmonic analysis of electric motor drives and Induction Furnace effect of harmonic distortion in the steel plant (Figure 1). The steel plant considered in this study produces 2500 tons steel per day. The plant electrical tariff is Rs. 60 Lacs per Month and motor drives and Induction furnace alone consume nearly 45-55% of power according to their operational load. In the steel industry, the motor drives and Induction furnace are used in different power ratings for various applications such as Crushers, kiln cooling system, steel mill cooling, raw mill cooling, coal mill cooling, steel mill classifier, coal mill classifier, belt conveyors, hot metal heating etc. The drive motor rating varies from few KW to several hundred KW depending on the application.



ISSN: 2319-5967

ISO 9001:2008 Certified

International Journal of Engineering Science and Innovative Technology (IJESIT)

Volume 2, Issue 2, March 2013

### III. HARMONIC PROFILE WITHOUT FILTER

#### A. 132 kW blower id fan

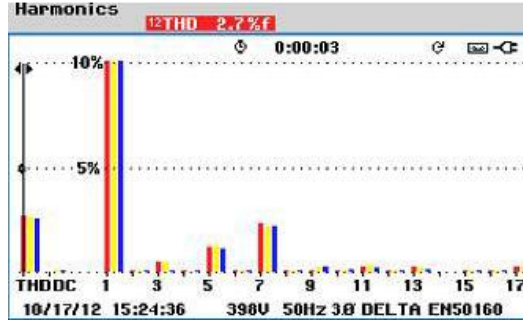


Fig.3.1 (a) Voltage harmonics of blower fan

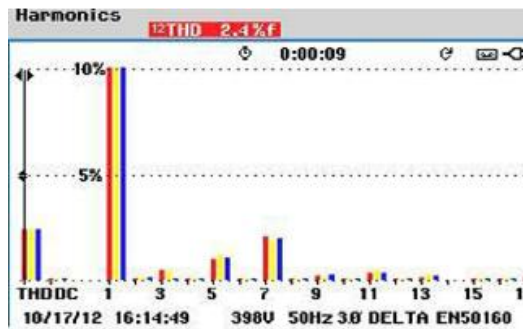


Fig.3.1 (b) Current harmonics of blower fan

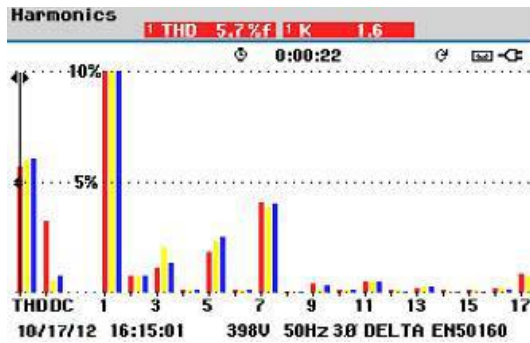


Fig.3.2 (a) Voltage harmonics of blower fan

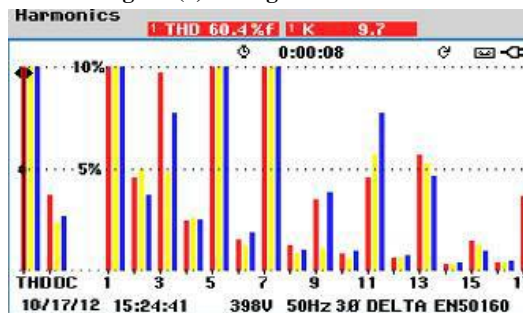


Fig.3.2 (b) Current harmonics of blower fan

IV. HARMONIC MITIGATING TRANSFORMERS OR MULTIPLES DISTRIBUTION

A. SIX PULSE

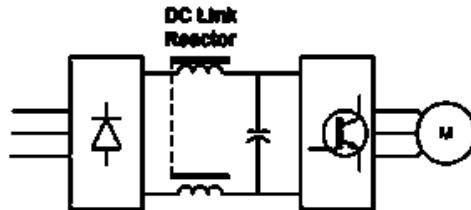


Fig 4.1 Six pulse arrangement.

B TWELVE PULSE

This is similar to a 12-pulse converter, on a macroscale. If two AFDs of equal HP and load are phase shifted by feeding one AFD from a delta/wye transformer, and feeding the second through a delta/delta transformer or a line reactor of equivalent impedance, performance similar to 12-pulse may be achieved. The cancellation will degrade as the load varies from AFD to AFD, although as the load on single AFD decreases, the individual distortion contribution percentage decreases, resulting in less of a need for cancellation. It is possible for a facility with a large number of AFDs to feed two halves of the distribution from phase-shifted transformers, yielding a large reduction in harmonic levels for minimal cost, and allowing a higher percentage of AFD loads under IEEE Std 519-1992 guidelines. Multiple transformers can be used to develop different phase shifts between sources of harmonic currents. For example, two transformers with a 50Hz phase shift of 30 degrees between them will result in cancellation of the 5th, 7th, 17th, and 19, etc. harmonics and will resemble a 12-pulse drive system. Four transformers shifted by 15 degrees with respect to each other will result in a 24-pulse distribution and will significantly minimize the resulting harmonics upstream of the common bus.

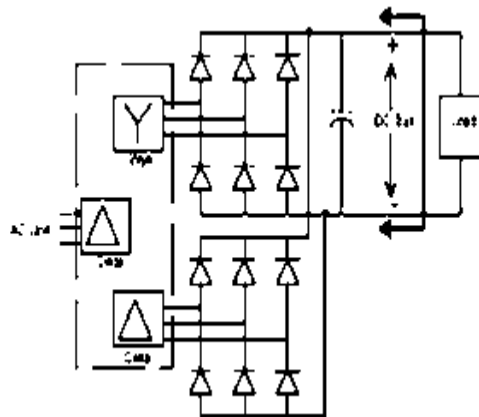


Fig.4.2 Twelve pulse transformer solution.

Advantages

- Cost may either be low or high depending on implementation
- Provides substantial reduction (50-80%) in voltage and current harmonics
- Provides increased input protection for AFD and its semiconductors from line transients

Disadvantages

- Cost may be low or high depending on implementation
- Impedance matching of phase shifted sources is critical to performance
- Maximum cancellation occurs only if drive loading is balanced
- May not reduce harmonic levels to below IEEE Std 519-1992 guidelines

C EIGHTEEN PULSE (18 pulses)

This method is similar to 12-pulse converters, although instead of using two phase shifted power sources and semiconductor bridges, three are used. One manufacturer uses a specially wound autotransformer (Differential Delta) and 18 input semiconductors. When this arrangement is used, over 90% of harmonic currents are canceled (Typical total harmonic current distortion of 2-3%). **to rectifier**

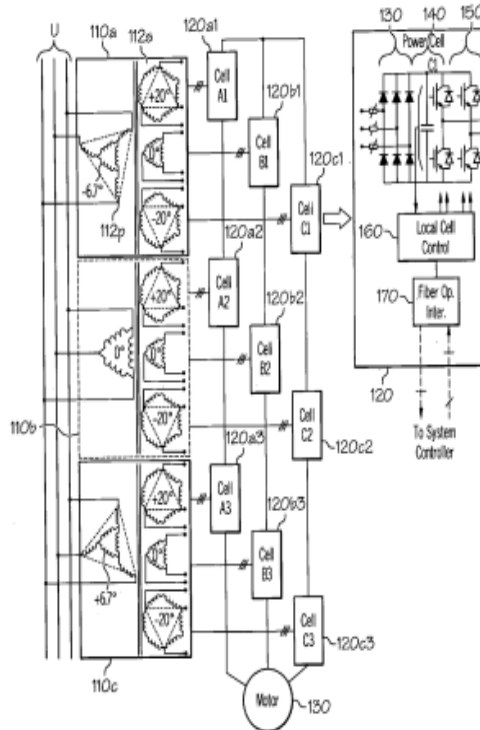


Fig. 4.3 Eighteen pulse transformer-winding connection

**Advantages**

- Virtually guarantees compliance with IEEE Std 519-1992 – excellent for drives >100 HP
- Provides increased input protection for AFD and its semiconductors from line transients
- Up to 4 times the harmonic reduction of 12 pulse methods
- Smaller transformer than isolation transformer used in 12-pulse converter

**Disadvantages**

- Higher cost (but much better performance)

**D. TWENTY FOUR (24) PULSE**

- This method is similar to 18-pulse converters, although instead of using four phase shifted power sources and semiconductor bridges, four are used. One manufacturer uses a specially wound autotransformer (Differential Star) and 24 input semiconductors. When this arrangement is used, over 95 % of harmonic currents are canceled (Typical total harmonic current distortion of 1.2-1.5%).

**Advantages**

- Virtually guarantees compliance with IEEE Std 519-1992 – excellent for drives >100 HP
- Provides increased input protection for AFD and its semiconductors from line transients

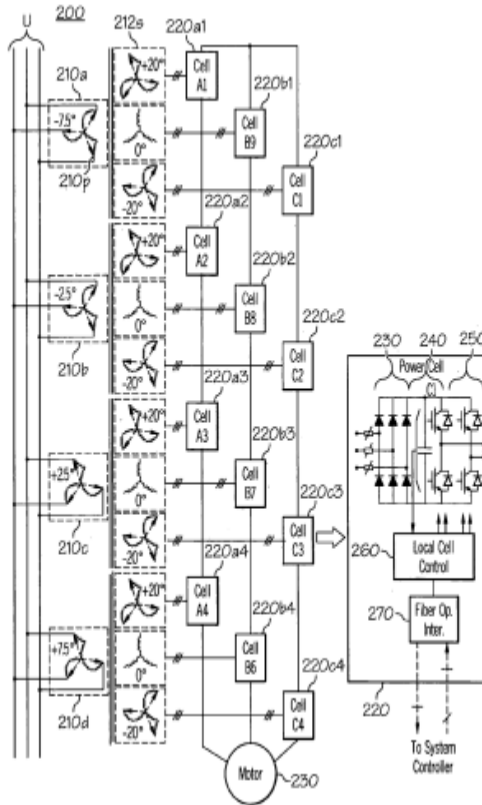


Fig. 4.4 Twenty-four pulse transformer-winding connection to rectifier

## V. TEST AND SIMULATION RESULT

### A. Six pulse simulation model

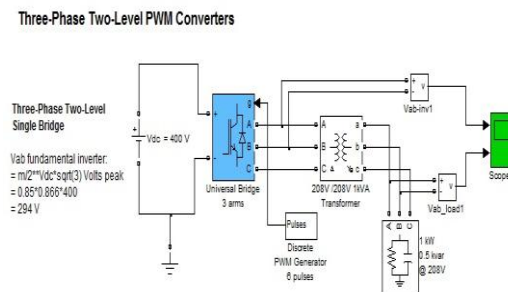


Fig 5.1 Six pulse simulation model

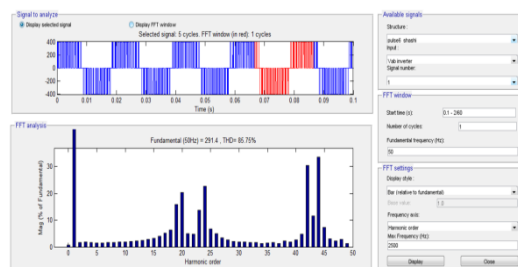


Fig 5.2 Six pulse voltage THD

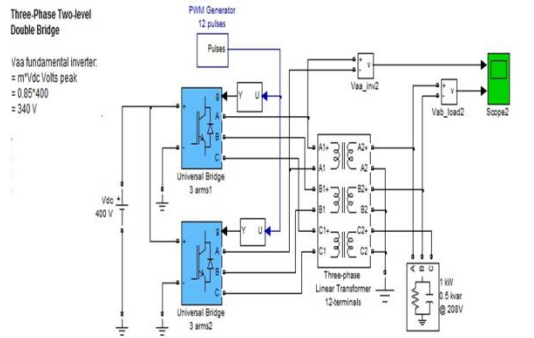


Fig 5.3 Twelve pulse simulation model

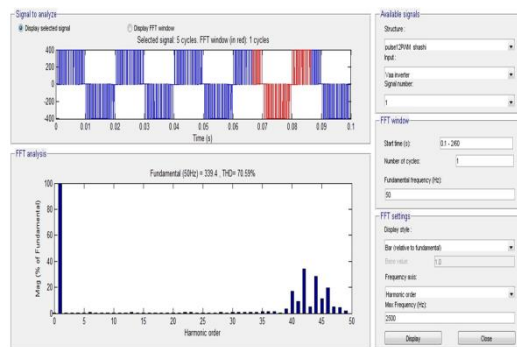


Fig 5.4 Twelve pulse voltage THD

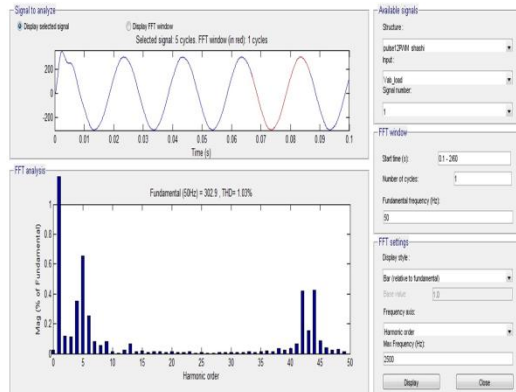


Fig 5.5 Twelve pulse current THD

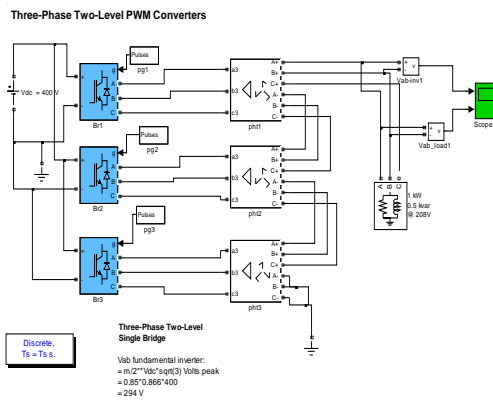


Fig 5.6 Eighteen pulse simulation model



ISSN: 2319-5967

ISO 9001:2008 Certified

International Journal of Engineering Science and Innovative Technology (IJEST)

Volume 2, Issue 2, March 2013

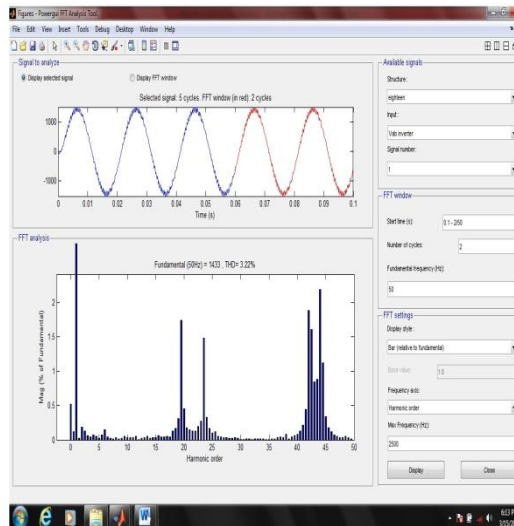


Fig 5.7 Eighteen pulse voltage THD


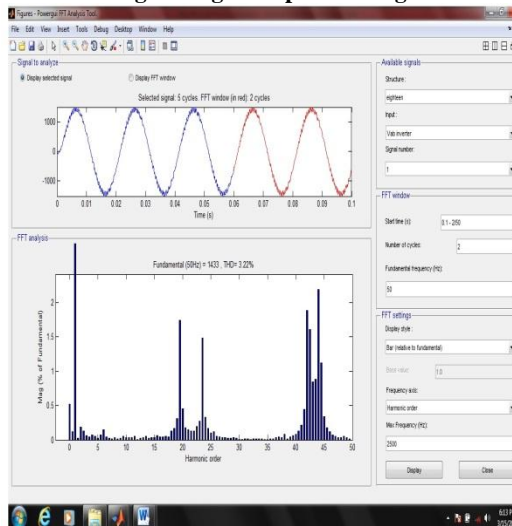


Fig 5.8 Eighteen pulse current THD

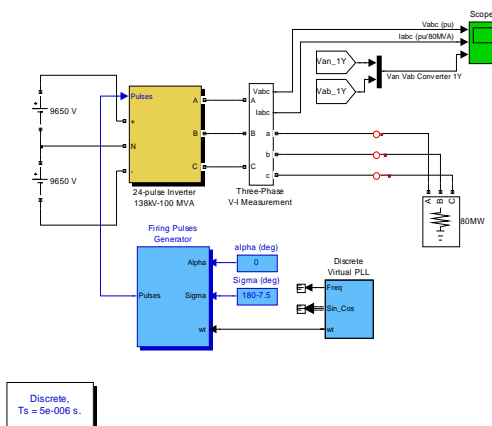

Discrete,  
Ts = 5e-006 s.

Fig 5.9 Twenty four pulse simulation model

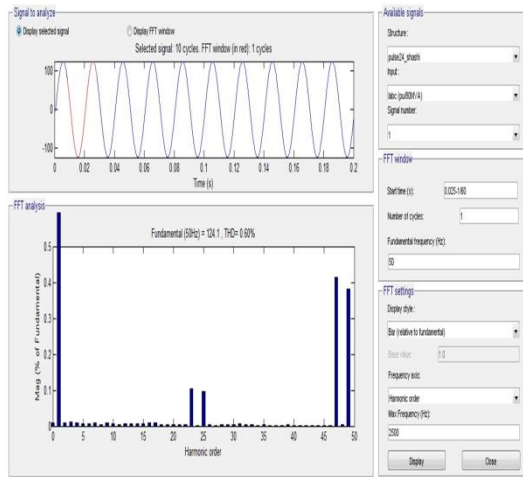


Fig 5.10 Twenty four pulse voltage THD

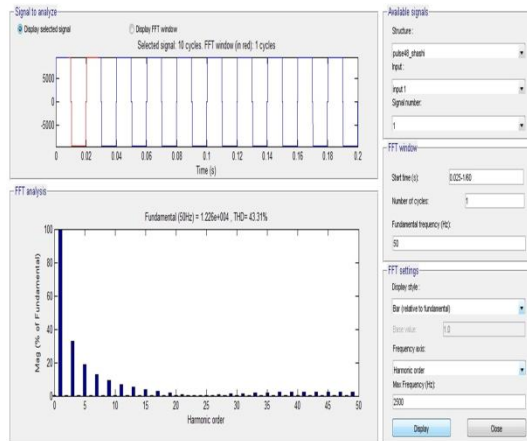


Fig 5.11 Twenty four pulse current THD

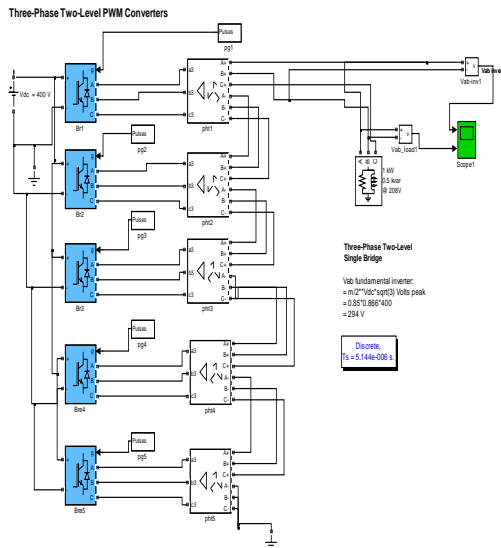


Fig 5.12 Thirty pulse simulation model





ISSN: 2319-5967

ISO 9001:2008 Certified

International Journal of Engineering Science and Innovative Technology (IJESIT)

Volume 2, Issue 2, March 2013

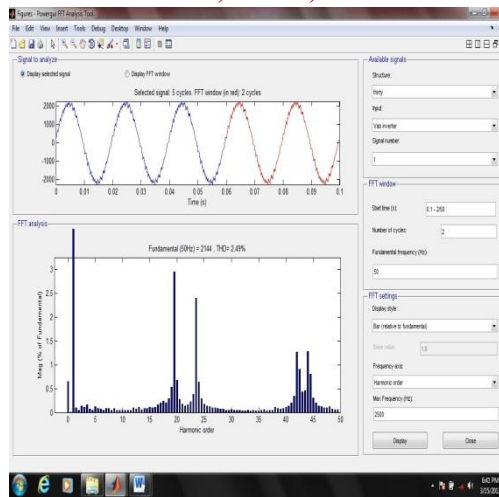


Fig 5.13 Thirty pulse voltage THD

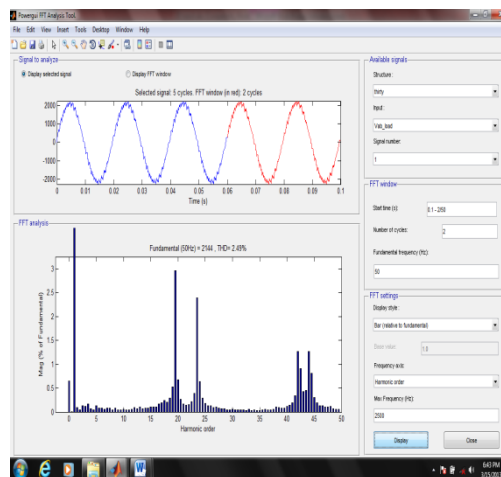


Fig 5.14 Thirty pulse current THD

## VI. CONCLUSION

This paper proposed several multi pulse based phase Autotransformers topologies to meet standard IEEE 519. Compared with other solutions, autotransformers possess such advantages as being simple, reliable, no resonance problem and relatively cost effective, as well as small physical size. The proposed AC/DC converter topologies utilizing these transformers were shown to not have current sharing problems. Working units at industrial field sites, ranging in HP sizes from 50 HP to 800 HP, are based on these topology patents [8-11]. The paper provided technical analysis and field site data on the new topologies, as well as comparison to other harmonic mitigation techniques versus horsepower size

## REFERENCES

- [1] IEEE Std. 519-1992. IEEE Recommended Practice and Requirements for Harmonic Control in Electrical Power Systems.
- [2] R.G.Ellis, "Harmonic Analysis of Industrial Power System," IEEE Transactions on Industry Applications, Vol. 32, No. 2, March/April 1996, pp. 417-421.
- [3] D. Zhou, N.N. Guskov, G.L. Skibinski, W.A. Maslowski and B.R. Buchholz, "LC Harmonic Filters - Practical Cost Effective Design Considerations for Adjustable Frequency Drives," PCIM 2000 Proceeding, October 2000, pp. 432-438.



ISSN: 2319-5967

ISO 9001:2008 Certified

**International Journal of Engineering Science and Innovative Technology (IJESIT)**

**Volume 2, Issue 2, March 2013**

- [4] M.F. McGranaghan and D.R. Mueller, "Designing Harmonic Filters for Adjustable-Speed Drives to Comply with IEEE-519 Harmonic Limits," IEEE Transactions on Industry Applications, Vol. 35, No. 2, March/April, 1999, pp. 312-318.
- [5] F.Z. Peng and D.J. Adams, "Harmonic Sources and Filtering Approaches," IEEE IAS annual conference, 1999.
- [6] K. Oguchi, G Maeda, N. Hoshi and T. Kubota, "Voltage-Phase Shifting Effect of Three-Phase Harmonic Canceling Reactors and Their Applications to Three-Level Diode Reactors," IEEE IAS Annual conference, 1999.
- [7] C. Niermann, L.F. Erzeugung and A.E. Anwendung, "New Rectifier Circuits with Low Mains Pollution and Additional Low Cost Inverter For Energy Recovery," EPE 1999, pp. 1131-1136.
- [8] M. Kang, B.O. Woo, P. Enjeti and I.J. Pitel, "Auto connected-Electronic- Transformer-Based Multi-pulse Rectifiers for Utility Interface of Power Electronic Systems," IEEE Transactions on Industry Applications, Vol. 35, No. 3, May/June, 1999, pp. 646-656.
- [9] J. Salmon and M. Ciulei, "An asymmetrical half-bridge active dc filter for industrial drive systems using multi-pulse utility rectifiers with harmonic reducing transformers," IEEE IEMDC Conf., June 2003, pp. 876-882.
- [10] D. Zhou, G. Skibinski, and N. Guskov, "Nine Phase Transformer", U.S Patent #6,335,872, Jan 2002.
- [11] D. Zhou, G. Skibinski, and N. Guskov, "Nine Phase Transformer", U.S Patent #6,249,443, June 2001.
- [12] D. Zhou, G. Skibinski, and N. Guskov, "Twelve Phase Transformer Configuration ", U.S Patent #6,198,647, Mar 2001.
- [13] D. Paice, "Multi-Pulse converter system", U.S Patent #4,876,634, Oct 1989.
- [14] D. Hammond, "Autotransformer", U.S Patent #5,619,407, April 1997.
- [15] D. Paice, "Optimized 18-pulse type ac/dc or dc/ac Converter System", U.S Patent #5,124,904, Jun 1992.
- [16] J. Traver et al, "Multiphase low harmonic distortion transformer", U.S Patent #4,779,181, Oct 1988.
- [17] D. Paice, "Symmetrical, phase-shifting, Fork-transformer", U.S Patent #5,455,759, Oct 1995.
- [18] D. Paice, "Power Electronic Converter harmonics: Multi-pulse methods for clean power, IEEE press, 1996", U.S Patent #5,455,759, Oct 1995.
- [19] R. Hoadley, "Line and Load Considerations for AC Drives: Harmonics", Rockwell Automation Allen Bradley 2002 Automation Fair, Anaheim, Ca.
- [20] ANSI C57.110-1986, "IEEE Recommended practice for establishing transformer capability when supplying non-sinusoidal load currents", 1430 Broadway, New York, NY.